

# Reflux Power Setting

## Equipment Required




- Inverter with Built-in Anti-Reverse Power Controller
- CT
- Network cable
- CT port
- Terminal cap



## Wiring

Step 1: connect CT and Network cable


- connect the orange wire and green wire to the positive pole of CT using a terminal cap, fasten the wire using crimping tool.
- connect the blue wire and brown wire to the negative pole of CT using a terminal cap, fasten the wire using crimping tool.

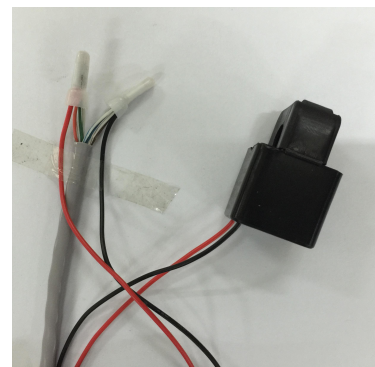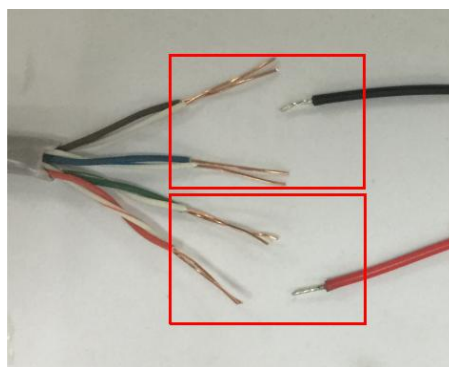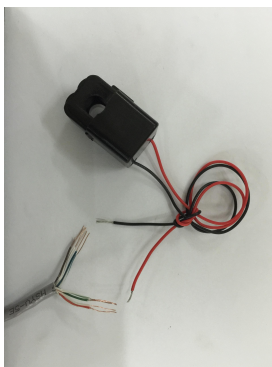

Step 2: Remove the waterproof cover using a screwdriver. Unlock the waterproof cable gland,remove the stopper in the waterproof connector.





Step 3: Insert the other end of Network cable through the cable gland and waterproof.

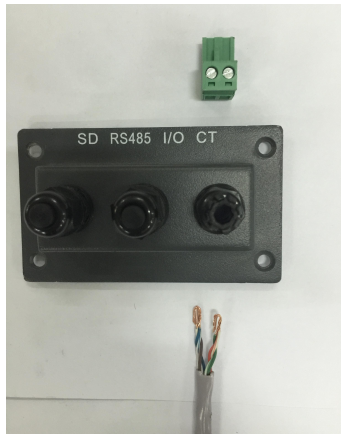


Step 4: Connect Network cable and CT port, secure the wires using a slotted screwdriver.


- Connect positive pole of CT to the left side of CT port,secure the wires using a slotted screwdriver
- Connect negative pole of CT to the right side of CT port,secure the wires using a slotted screwdriver

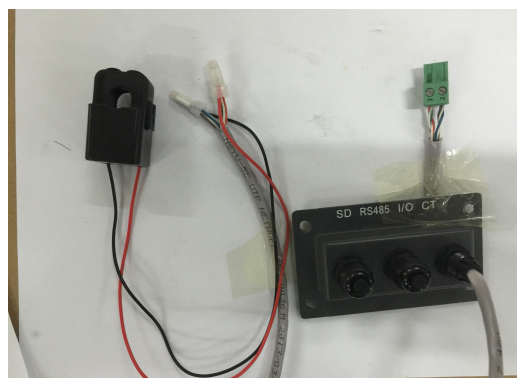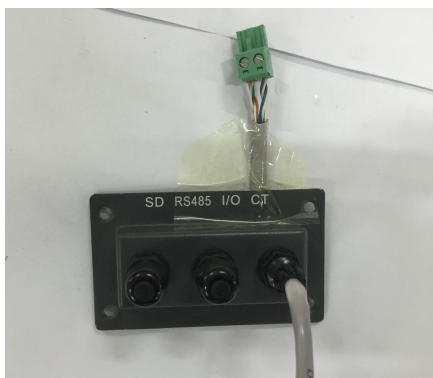

Step 5: Tighten the screws to fix the waterproof cover, rotate the cable gland clockwise to fasten it securely.

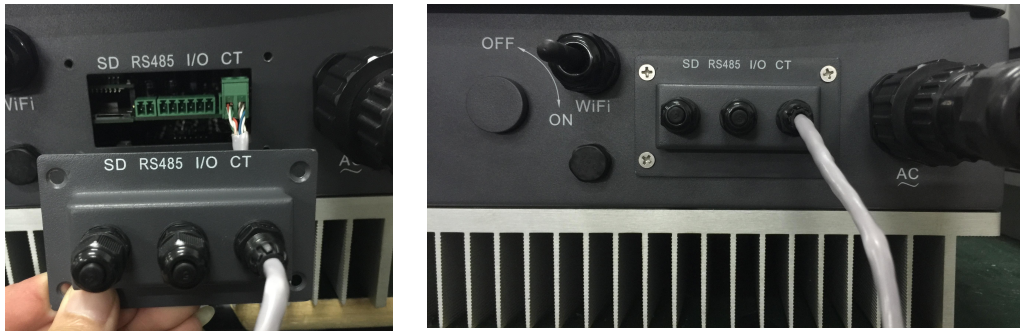



Step 6: Place CT at correct position.

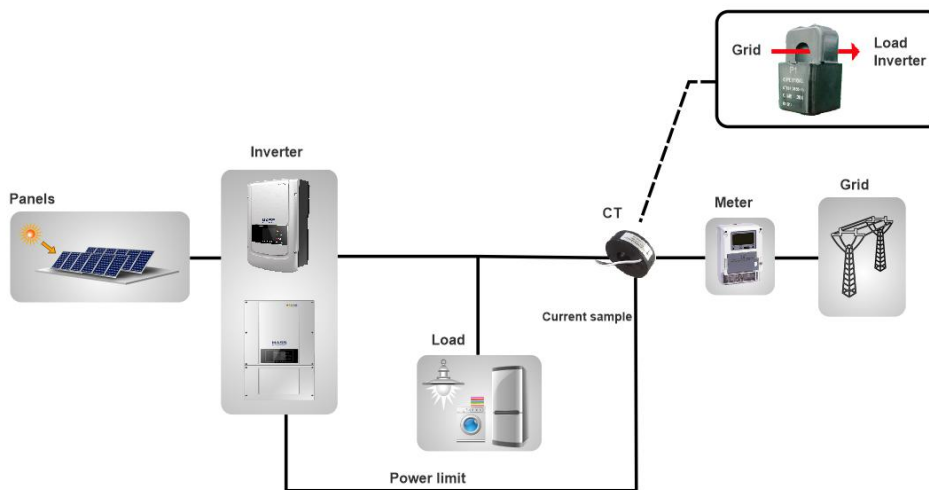



Step 7: Power to unit.

Step 8: Set Reflux power in screen.

Press "Back" in standard interface to enter main interface. Select "1.Enter setting", press "OK". then press "UP" and "DOWN" to find "Set RefluxP".

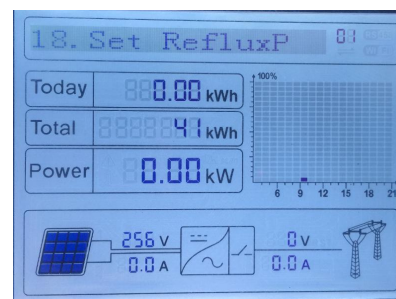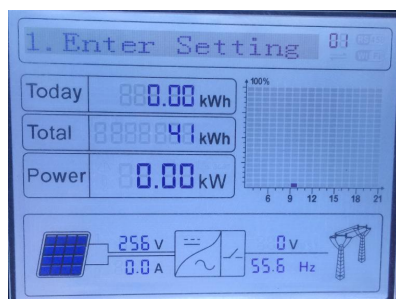

Select "Set RefluxP", press "OK", then "Input Password" will be displayed, press "OK" again to input the password (0001), press "Up" or "Down" to change the number, press "OK" to go to next digit.

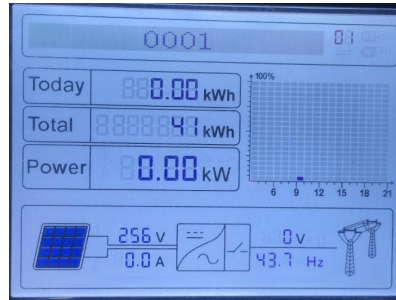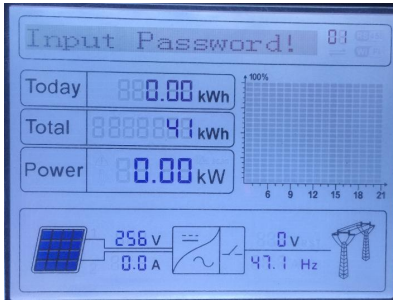

Press "OK" to enable Reflux Power, then input the Reflux Power value, press "Up" or "Down" to change the number, press "OK" to go to next digit. After this, press "OK", "success" is displayed when the Reflux Power is correct.

